




VALLEY GUTTER
SECTION A - A

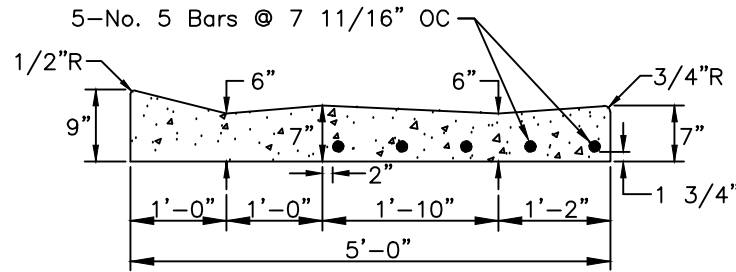

VALLEY GUTTER
TRANSITION
SECTION B - B

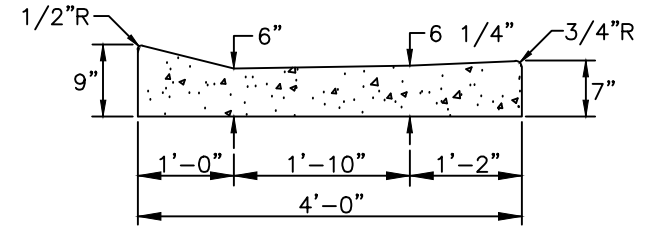

VALLEY GUTTER
TRANSITION
SECTION C - C

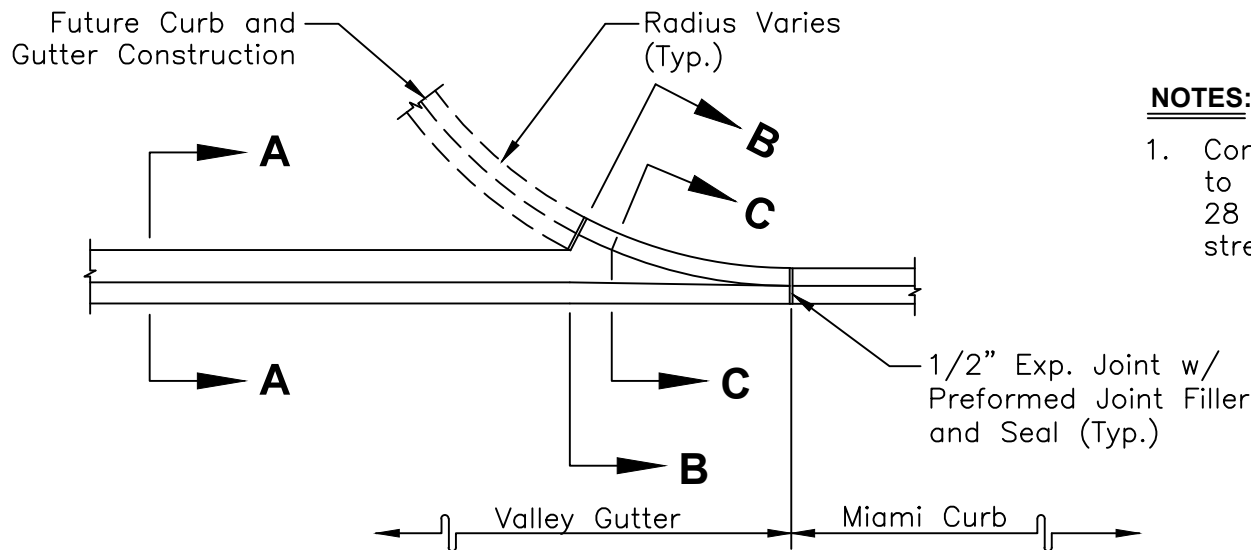

NOTES:

- Concrete for Valley Gutter to be Class I, minimum 28 Day compressive strength of 3000 psi

REVISION DATE:

10/21

TRANSPORTATION
TECHNICAL
MANUAL



Hillsborough
County Florida

INTERSECTION VALLEY GUTTER
TYPICAL DETAILS

DRAWING NO. **TD-6**

SHEET NO. 1 OF 1